



OMX 380iDU



- Input for potentiometer
- Output 0/4...20 mA/0...5 mA/0...2/5/10 V/±10 V
- Rate up to 7200 meas./s
- Teach-in, Digital filters, Tare, Linearization
- Quick configuration by DIP switch
- PC configurable via USB port
- Galvanic separation 2.5 kVAC
- Power supply 10...30 VDC/24 VAC

Option


Data output

The OMX 380i model series are very fast DIN rail mountable digital transmitters with a Teach-in function.

Type OMX 380iDU is a isolated transmitter for potentiometers. Setting of both the input and output ranges can be done conveniently by a DIP switch located on the side of the housing or from a PC via the OM Link SW.

This device is based on a 32-bit processor, fast 24-bit $\Delta\Sigma$ ADC with PGQ and 16-bit DAC, which guarantees high accuracy and excellent stability.

DIGITAL ISOLATED TRANSMITTER

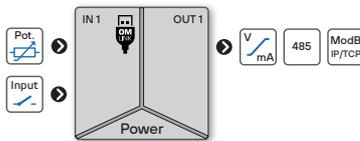

OPERATION

The device can be configured either by DIP switches located on the side of the housing or by PC using the OM Link SW. The same SW can be used to edit and archive all device settings, as well as to perform firmware updates and customer calibration. A standard microUSB cable is required for PC to device connection.

Tech-in process can be performed for the measuring range currently selected using the front panel buttons.

All settings are stored in the EEPROM memory (preserved even after power-off).

OPTION

DATA OUTPUTS are for their rate and accuracy suitable for transmission of the measured data for further projection or directly into the control systems. We offer an isolated RS485 with ASCII protocol.

STANDARD FUNCTIONS

PROGRAMMABLE INPUT

Standard setting: any display values can be assigned to Min and Max values of a defined standard input signal

Teach-in: any display values can be assigned to Min and Max values of actual (unknown) input signal

Manual setting: known Min and Max input signal values can be entered manually and any display values can be assigned to each signal

ANALOG OUTPUT

Type: isolated, programmable with a resolution of 16 bit, rate < 160 μ s

Ranges: 0...2/5/10 V/±10 V, 0...5 mA/0/4...20 mA

FUNCTIONS

Linearization: non-linear signal is converted by a 100-point linear interpolation

Tare: designed to reset display upon non-zero input signal

Fixed tare: fixed preset tare

Min./max. value: registration of min./max. value reached during measurement

Simulation: test mode in which range, value and duration of the step can be set

Math functions: polynomial, inverse polynomial, logarithm, exponential, power, root

DIGITAL FILTERS

Floating average: from 2...30 measurements

Exponential average: from 2...100 measurements

Arithmetic average: from 2...100 measurements

Rounding: setting a „shorter“ number for further signal processing

EXTERNAL CONTROL

Hold: display/instrument blocking

Lock: control keys blocking

Tare: activation and tare resetting

Resetting Min/Max: resetting min/max value

Hold Min/Max: start of a measurement to evaluate the Min/Max value

Sample: start of a one-time measurement

TECHNICAL DATA

INPUT

No. of inputs	1
	The range is selectable either by DIP switch or by OM Link free SW from PC
DU Sensor power supply	2.5 VDC/3 mA, potentiometer resistance > 500 Ω

EXTERNAL INPUT

No. of inputs	2, on contact																				
Function	<table border="0"> <tr> <td>OFF</td> <td>no function assigned</td> </tr> <tr> <td>TARE</td> <td>tare activation</td> </tr> <tr> <td>CL.TAR</td> <td>reset of Tare</td> </tr> <tr> <td>CL.M.M</td> <td>reset of Min./Max. values</td> </tr> <tr> <td>HOLD</td> <td>measurement paused</td> </tr> <tr> <td>SAMPLE</td> <td>take a one-off measurement</td> </tr> <tr> <td>HLD.MIN</td> <td>start measurement of MIN</td> </tr> <tr> <td>HLD.MAX</td> <td>start measurement of MAX</td> </tr> <tr> <td>HLD.M-M</td> <td>start measurement of MAX-MIN</td> </tr> <tr> <td>KEY.LCK</td> <td>device buttons blocked</td> </tr> </table>	OFF	no function assigned	TARE	tare activation	CL.TAR	reset of Tare	CL.M.M	reset of Min./Max. values	HOLD	measurement paused	SAMPLE	take a one-off measurement	HLD.MIN	start measurement of MIN	HLD.MAX	start measurement of MAX	HLD.M-M	start measurement of MAX-MIN	KEY.LCK	device buttons blocked
OFF	no function assigned																				
TARE	tare activation																				
CL.TAR	reset of Tare																				
CL.M.M	reset of Min./Max. values																				
HOLD	measurement paused																				
SAMPLE	take a one-off measurement																				
HLD.MIN	start measurement of MIN																				
HLD.MAX	start measurement of MAX																				
HLD.M-M	start measurement of MAX-MIN																				
KEY.LCK	device buttons blocked																				

INSTRUMENT SPECIFICATION

TC	15 ppm/°C
Accuracy	±0.01% of FS
Rate	100...7 200 measurements/s <i>speed of 400 meas./s is with FFT signal filtering</i>
Latency	< 580 μs
Overload	10x (t < 30 ms), 2x
Functions	Teach-in, tare, preset tare, min/max value, math. functions, delayed start, simulation
Digital filters	exponential / floating / arithmetic average, rounding
Math functions	polynomial / inverse polynomial / logarithm / exponential / power / root
Linearization	linear interpolation in 100 points <i>setup only via OM Link</i>
OM Link	company communication interface for operation, setting and update of instruments (microUSB)
Watch-dog	reset after 500 ms
Calibration	at 25°C and 40% rh.

ANALOG OUTPUT

No. of outputs	1
Type	isolated, adjustable with 16-bit DAC, output type and range is selectable
TC	15 ppm/°C
Non-linearity	0.024 % from FS
Accuracy	±0.02% of FS ±0.03% of FS ±0.05% of FS
Rate	response to change of value < 160 μs
Ranges	0...5 V 0...2 V / 0...5 mA 0...2 / 5 / 10 V, ±10 V, resistive load ≥ 1 kΩ 0...5 / 20 mA / 4...20 mA, comp. < 600 Ω / 12 V Indication of broken current loop Indication of error message (output < 3.2 mA)

DATA OUTPUTS

No. of outputs	1
Protocol	ASCII, Modbus RTU / TCP
Data format	8 bit + no parity + 1 stop bit
Rate	300...230 400 Baud
RS 485	isolated, addressing (max. 31 instruments)
Ethernet	10/100BaseT, Modbus TCP/IP (Slave)

POWER SUPPLY

Range	10...30 VDC / 24 AC, ±10 %, PF ≥ 0.4, I _{typ} < 40 A / 1 ms, isolated <i>Protection by fuse inside the device</i>
Consumption	< 1.4 W / 13 VA

MECHANIC PROPERTIES


Material	PA66, incombustible UL 94 V-0, blue
Dimensions	25 x 79 x 90.5 mm (w x h x d)
Installation	to DIN rail 35 mm wide

OPERATING CONDITIONS

Connection	connector terminal blocks, section < 1.5 mm ²
Stabilization period	within 5 minutes after switch-on
Working temperat.	-20°...60°C
Storage temperat.	-20°...85°C
Working humidity	< 95 % r.v., non condensing
Protection	IP20
Construction	safety class I
El. safety	EN 61010-1, A2
Dielectric strength	2.5 kVAC for 1 min. test between supply and input 2.5 kVAC for 1 min. test between input and outputs
Insulation resist.*	for pollution degree II, measurement cat. III power supply > 300 V (PI), 255 V (DI) Input/outputs > 300 V (PI)
EMC	EN 61326-1, Industrial area
Seismic qualification	IEC/IEEE 60980-344 Edition 1.0, 2020, par. 6, 9
Mechanical resistance	EN 60068-2-6 ed. 2:2008

* PI - Primary insulation, DI - Double insulation

CONNECTION

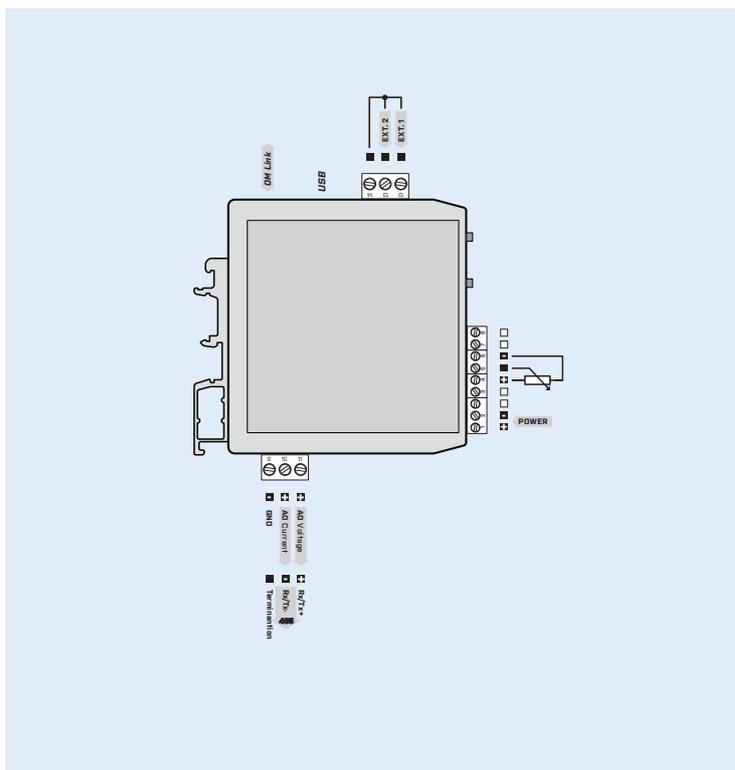

ORDER CODE

OMX 380iDU

- -

Output	Analog	1
	Data - RS 485	2
	Data - Ethernet	3
Specification	customized version, do not fill in	00



Presented by: Absolute Gauge Technologies
 sales@absolutegauge.com; www.absolutegauge.com,
 Toronto: 416 754 3168, Montreal: 514 695 5147,
 Toll Free: 1 888 754 7008

Basic configuration of the instrument is indicated in bold.